OIL TANK REPLACEMENT STATE UNIVERSITY OF NEW YORK COLLEGE AT PURCHASE

75 ANDERSON HILL ROAD PURCHASE, NEW YORK

PREPARED FOR:



DRAWING INDEX

TITLE G-001 C-100 2 C-200

COVER PAGE AND DRAWING INDEX LAYOUT AND GRADING PLAN

		SUBMITTAL / REVISIONS						E
No.	DATE	DESCRIPTION	BY	REVIEWED BY:	DATE	PROJ. MANAGER:	SNM	ST AL
1	03/22/22	BID SUBMISSION	PJA	JMB	03/18/22	CHIEF DESIGNER:	SNM	S T
						DESIGNED BY:	SNM	
						DRAWN BY:	PJA	EN E
						CHECKED BY:	JMB	CENSET
								A PO


EXISTING CONDITIONS AND REMOVALS PLAN





THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, (I.E.) ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS "A" MISDEMEANOR.





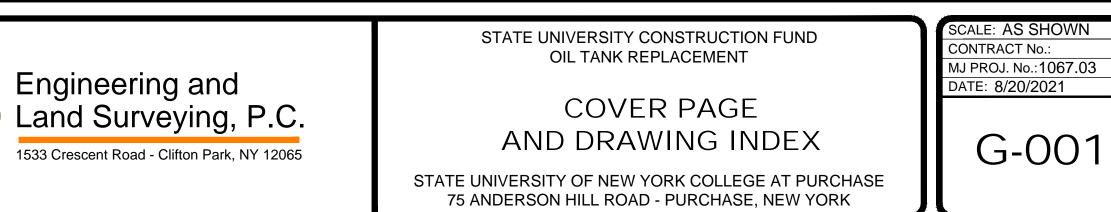

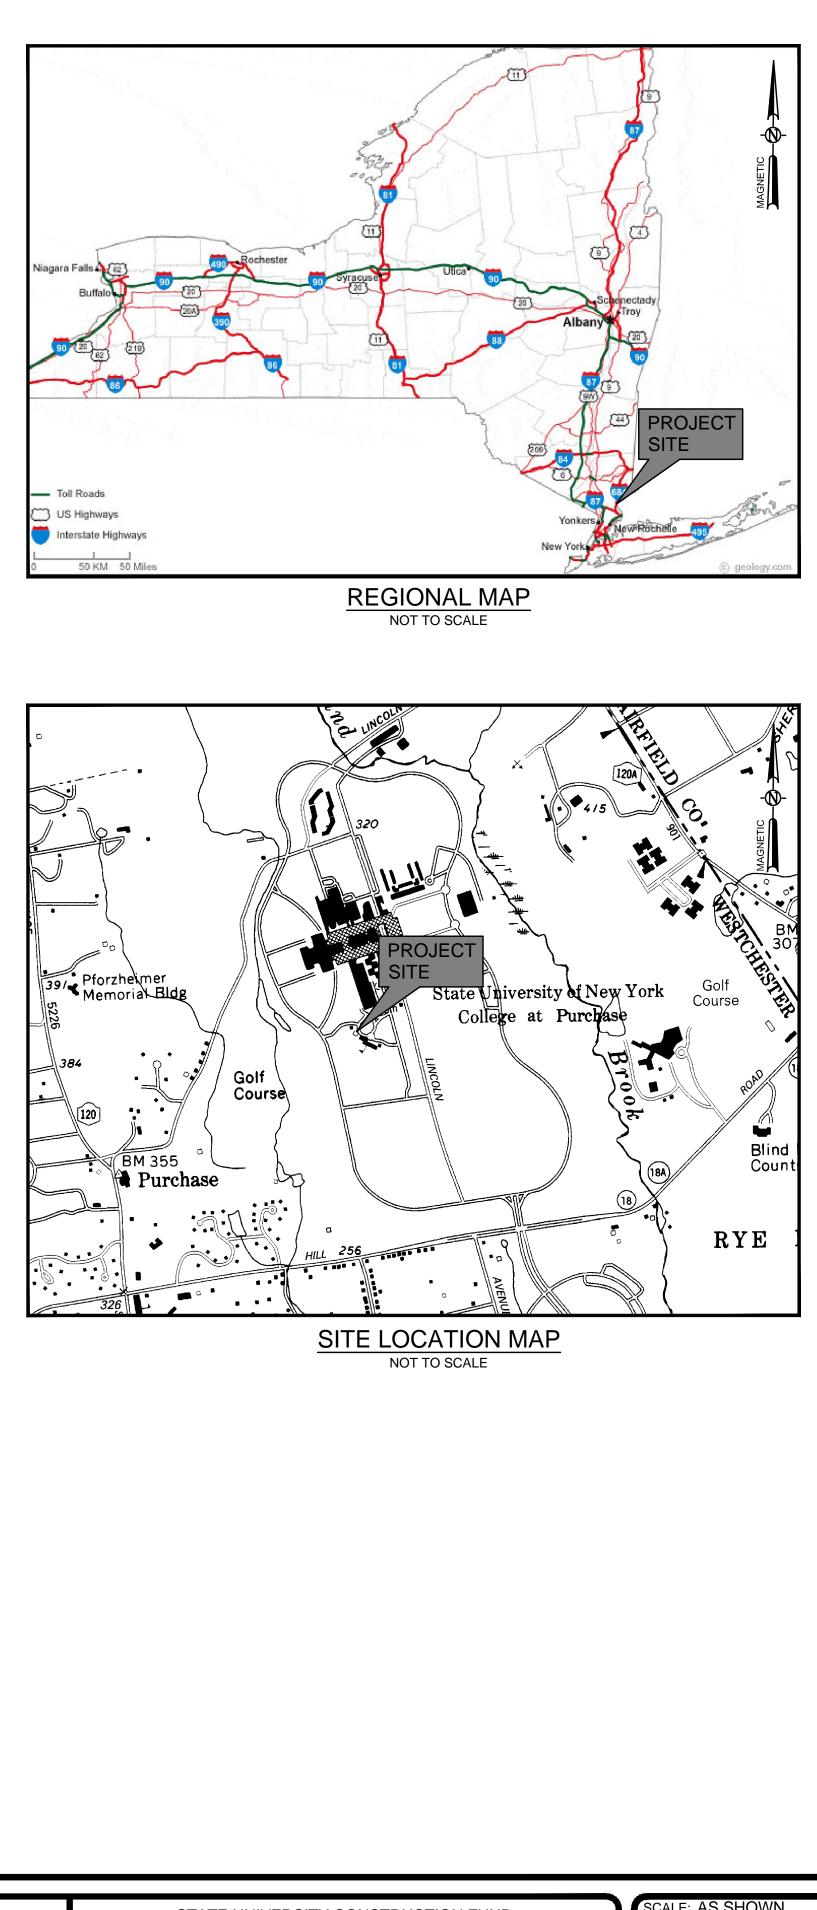

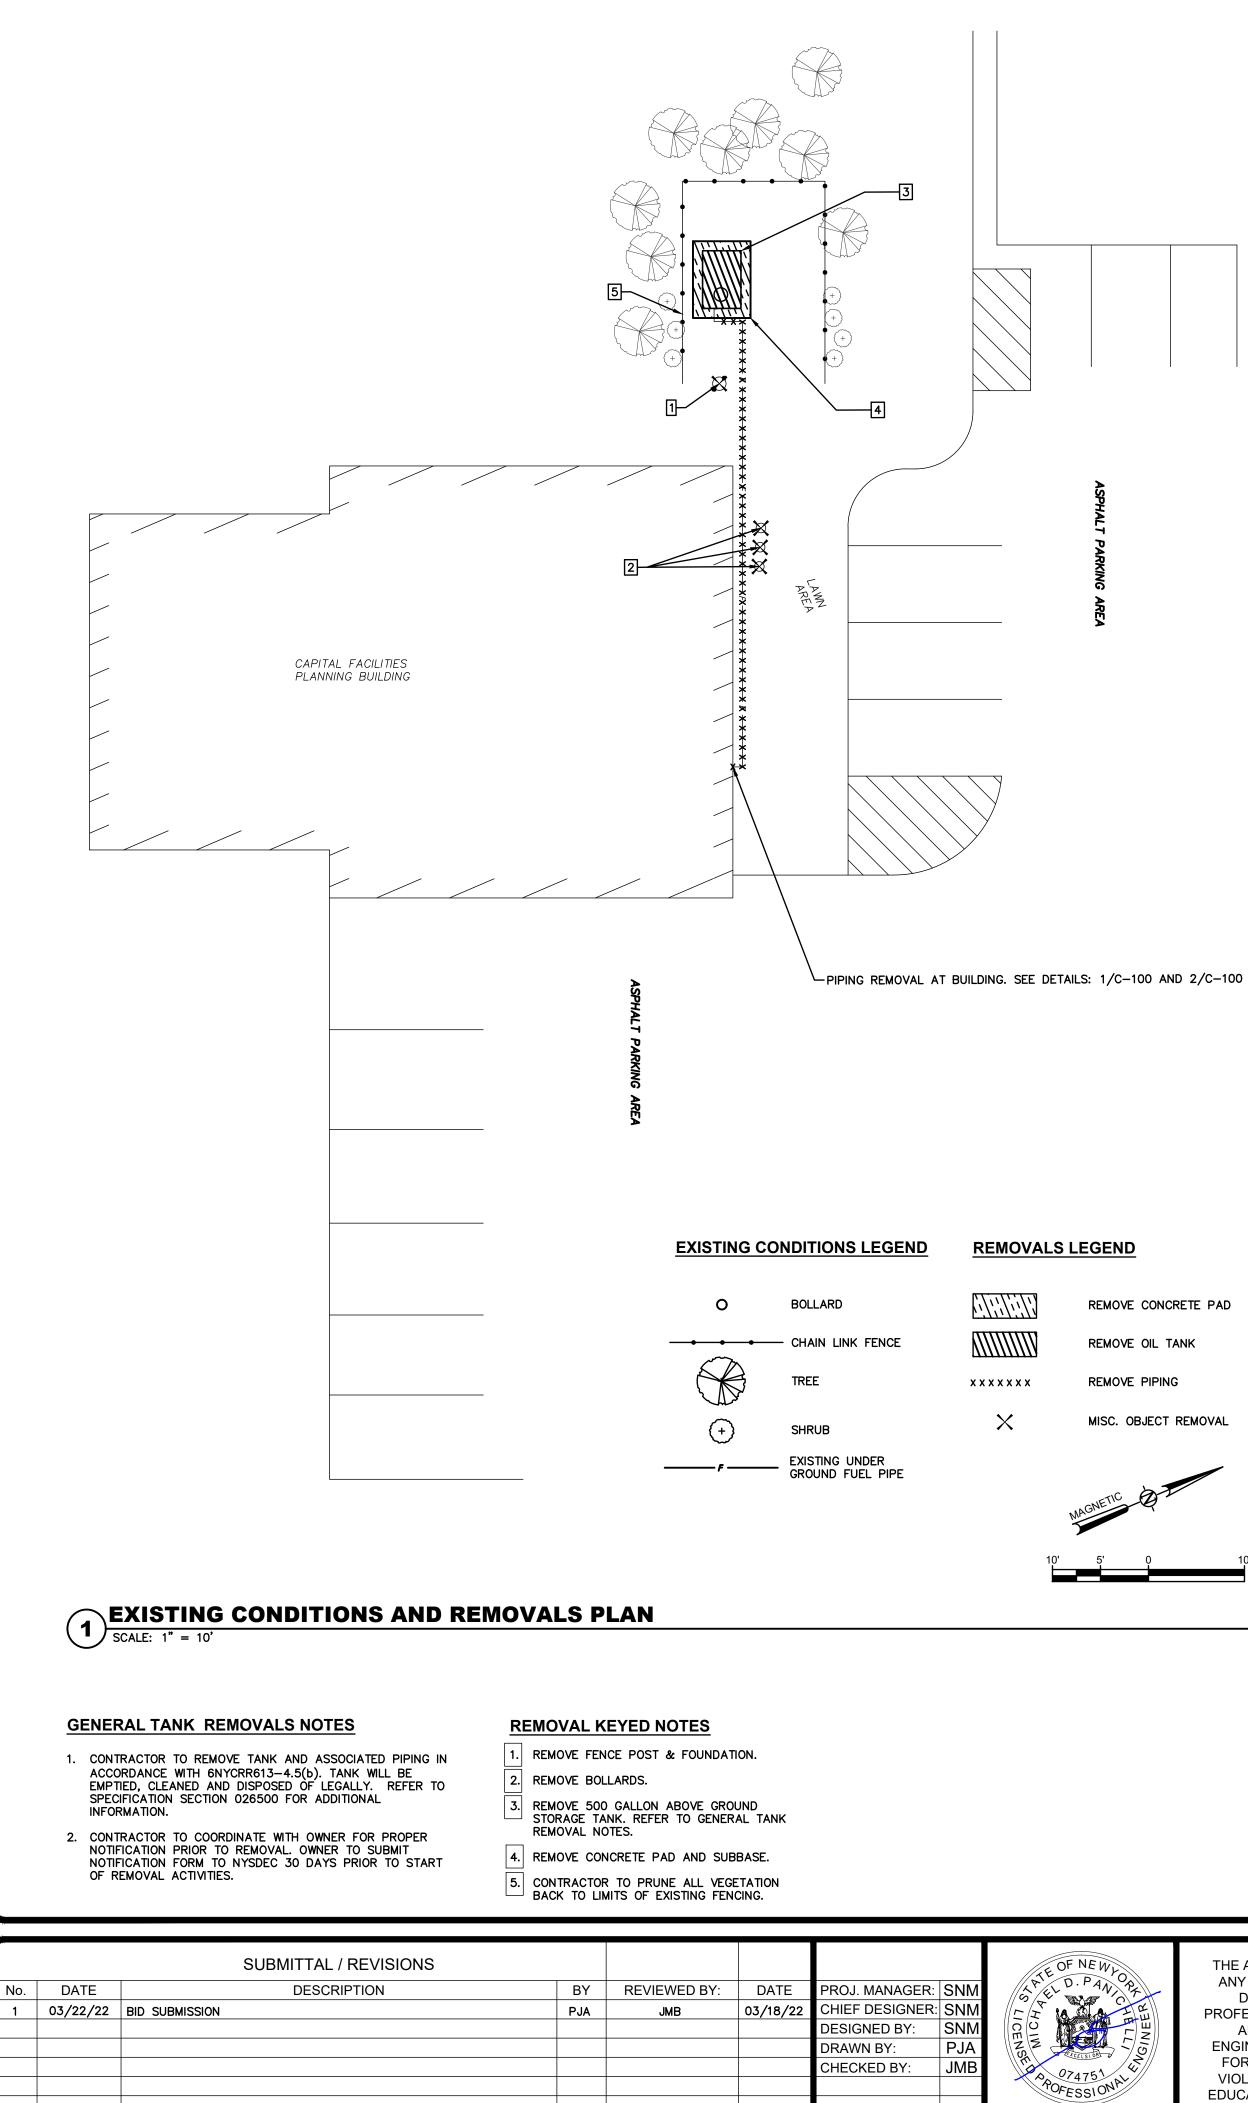

SEAL






BUILDING PENETRATION SCALE: N.T.S.


THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, (I.E.) ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS "A" MISDEMEANOR.







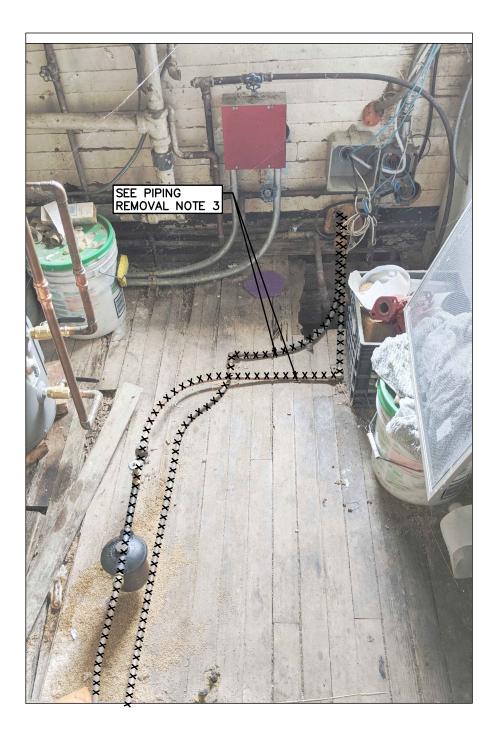

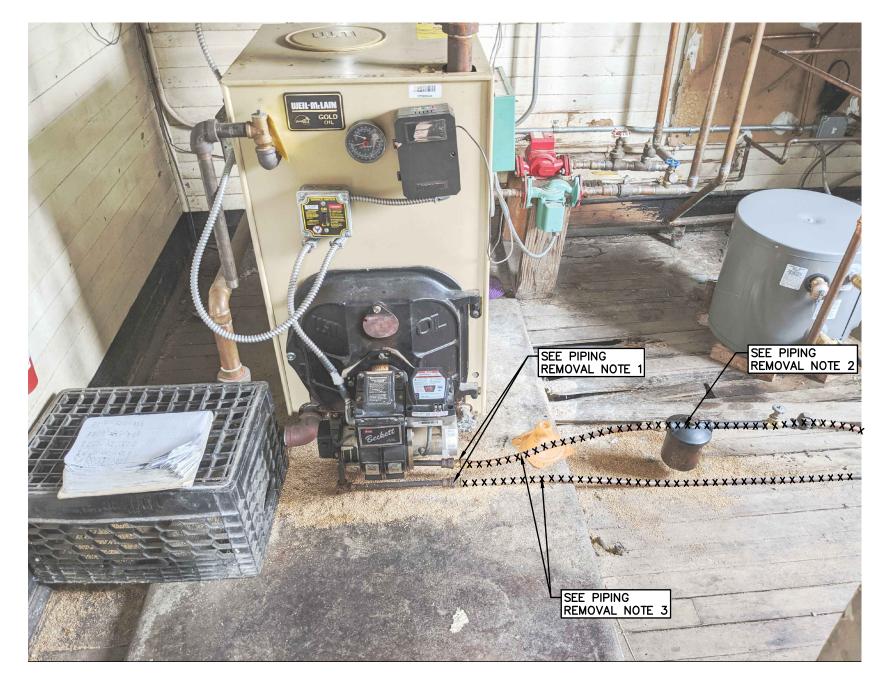

PIPING REMOVAL NOTES:

- 1. CONTRACTOR TO REMOVE ALL PIPING BACK TO FITTING IDENTIFIED IN PHOTOS
- 2. FILTER AND HOUSING TO BE REMOVED AND REINSTALLED
- 3. CONTRACTOR TO CONFIRM EXISTING PIPE SIZES IN THE FIELD PRIOR TO SUBMITTING PROPOSED MATERIALS FOR APPROVAL

2 PIPING REMOVAL SCALE: N.T.S.




STATE UNIVERSITY CONSTRUCTION FUND OIL TANK REPLACEMENT

EXISTING CONDITIONS AND REMOVALS PLAN


SCALE: AS SHOWN CONTRACT No.: MJ PROJ. No.:1067.03 DATE: 8/20/2021

C-100

STATE UNIVERSITY OF NEW YORK COLLEGE AT PURCHASE 75 ANDERSON HILL ROAD - PURCHASE, NEW YORK

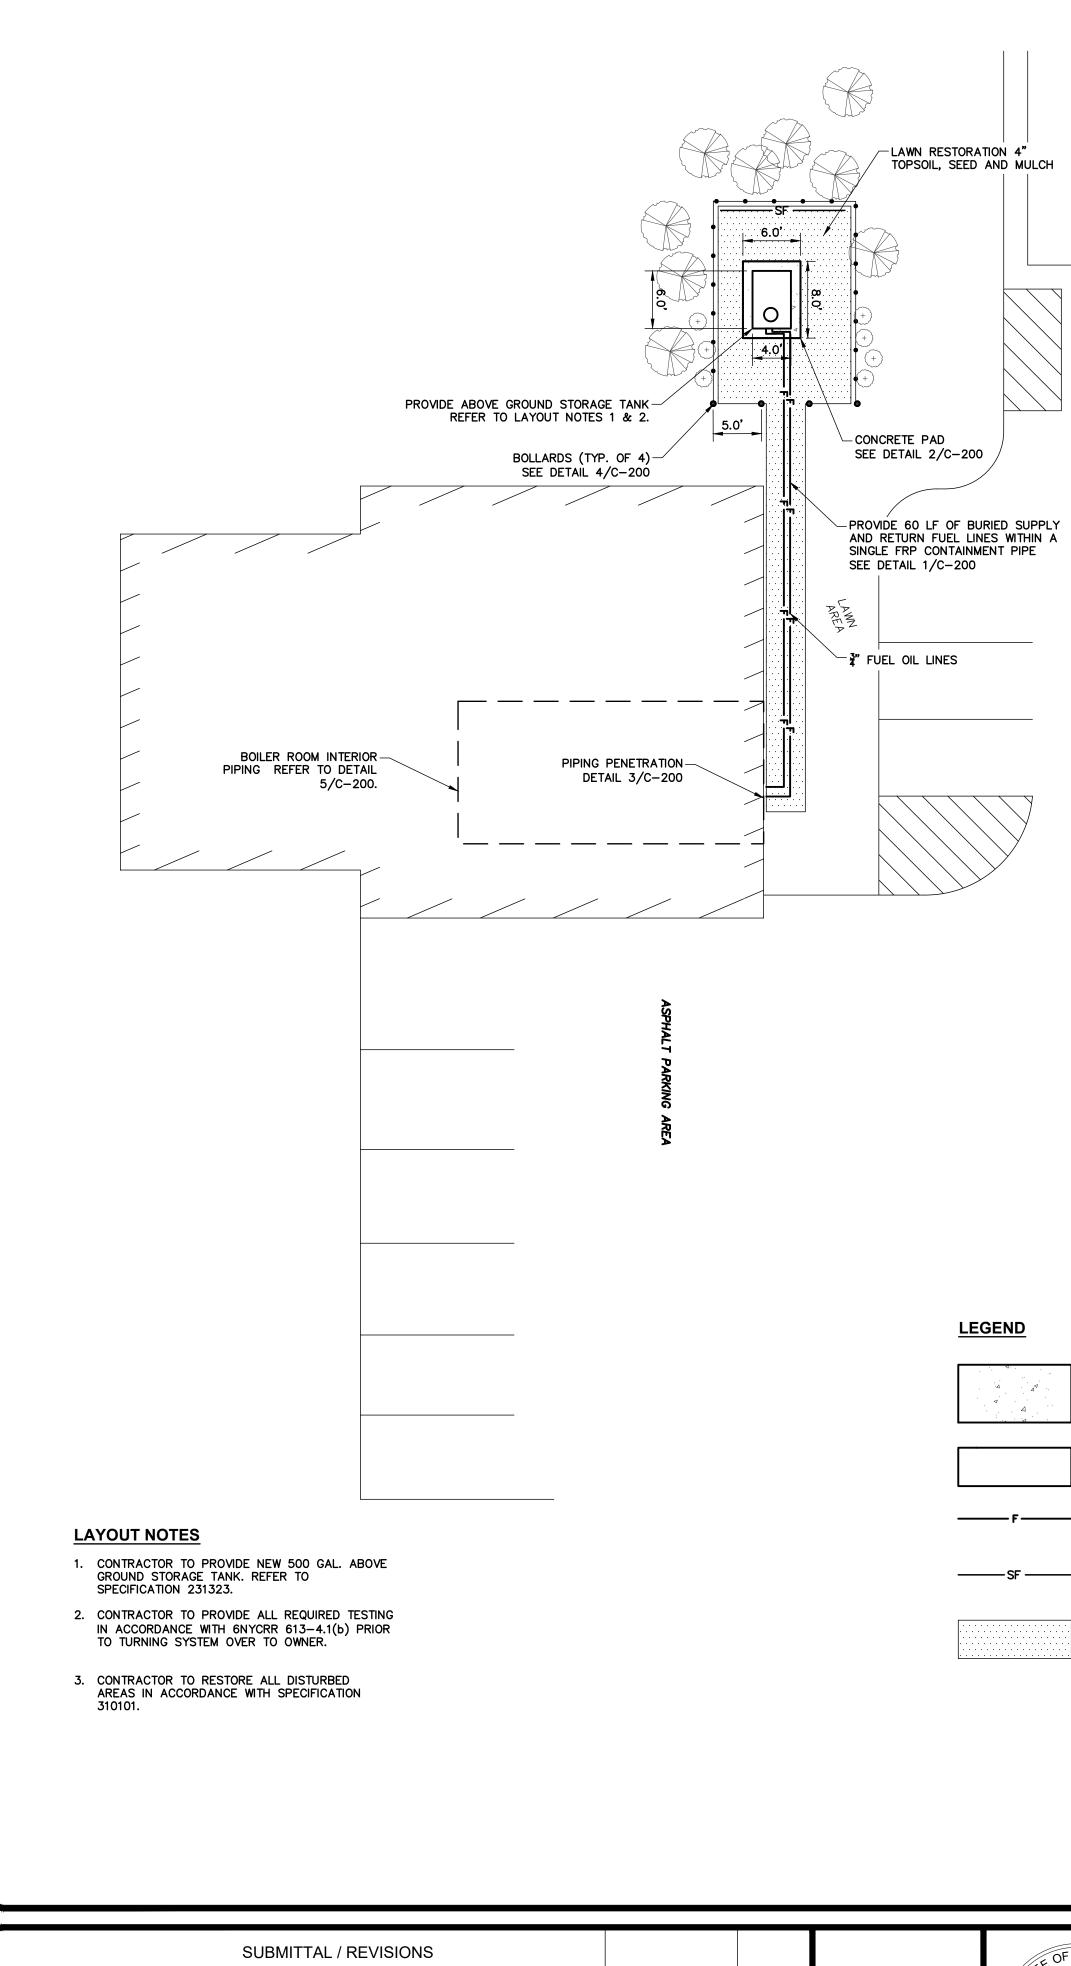

SUBMITTAL / REVISIONS								E OF NEWL
No.	DATE	DESCRIPTION	BY	REVIEWED BY:	DATE	PROJ. MANAGER:	SNM	LREL D. PAN P
1	03/22/22	BID SUBMISSION	PJA	JMB	03/18/22	CHIEF DESIGNER:	SNM	
						DESIGNED BY:	SNM	
						DRAWN BY:	PJA	
						CHECKED BY:	JMB	SET EXCELSION
								POFESSIONAL
								STESSIO.
								SEAL

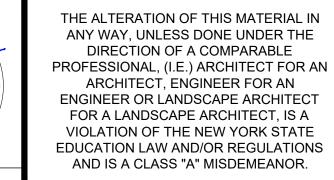

CONCRETE PAD


500 GALLON ABOVE









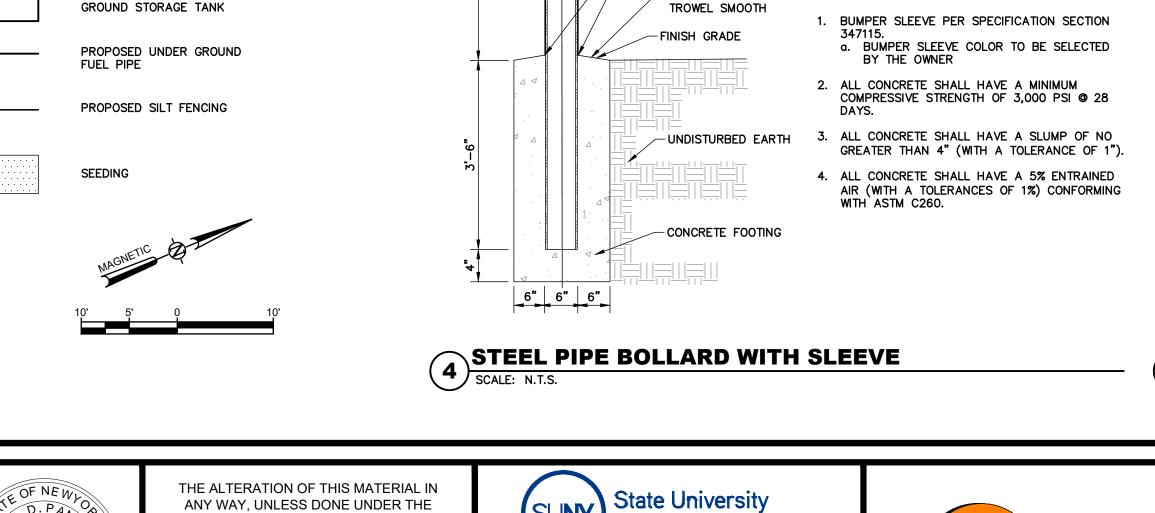

PIPE TRENCH AND BEDDING SCALE: N.T.S.

4. REFER TO SPECIFICATION SECTION 310000 FOR TRENCH BACKFILL, PIPE BEDDING AND BACKFILL, GRADATION AND COMPACTION REQUIREMENTS.

> -6" O.D. GALVANIZED STEEL PIPE - WITH ONE-PIECE BUMPER POST SLEEVE


-USE S.S. SECURITY SCREW

<u>NOTES:</u>

 $\frac{1}{4}$ " (torx center pin HEAD) AT BASE

- CROWN 1" AND

- 3. PLACE DETECTABLE WARNING TAPE 12" BELOW FINISHED GRADE.
- 2. ON-SITE EXCAVATED TRENCH MATERIAL MAY BE USED FOR TRENCH BACKFILL IF MEETING THE REQUIREMENTS OF SUITABLE MATERIAL.
- 1. D=OUTSIDE PIPE DIAMETER.
- NOTES:

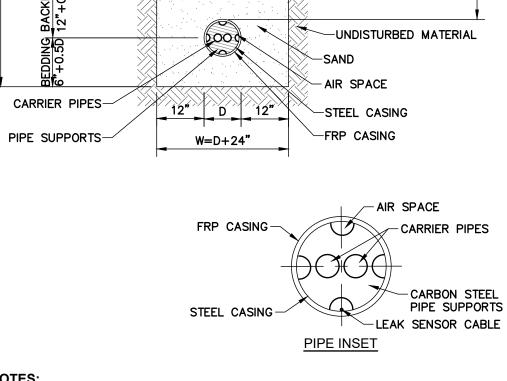

-DETECTABLE WARNING

(SEE NOTE 3)





MIN. LIMITS OF COMPACTED-

FINISH GRADE

STONE FILL


3/4" CHAMFER ALL SIDES -



TRENCH BACKFILL,

SUITABLE MATERIAL

티망

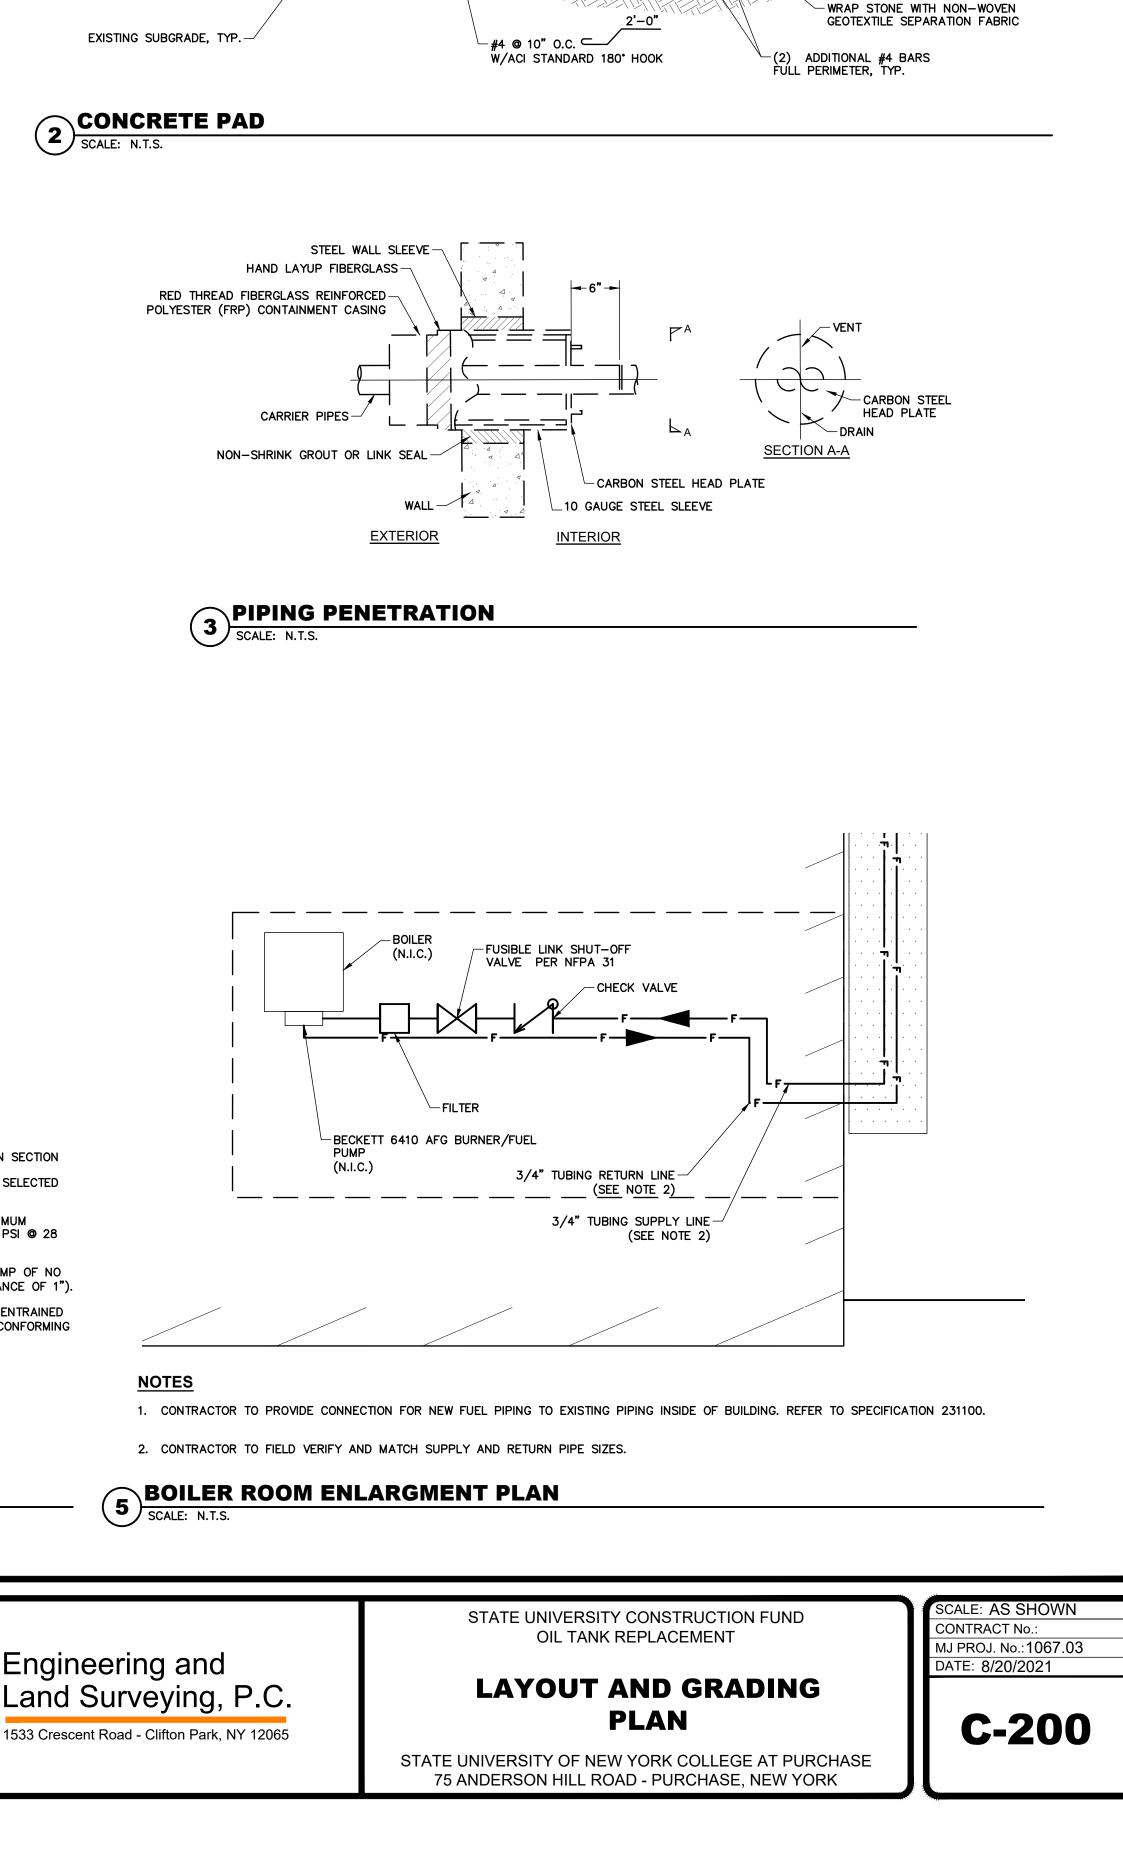

FINISH GRADE

FELEV. RESTORE TO MATCH EXISTING

BLEND OF NO.1 AND

NO.2 STONE

VARIES: SEE PLAN

REINFORCED W/#4 @ 10" O.C. T & B, EACH WAY

10" SLAB ON GRADE-